




H. CHILDER

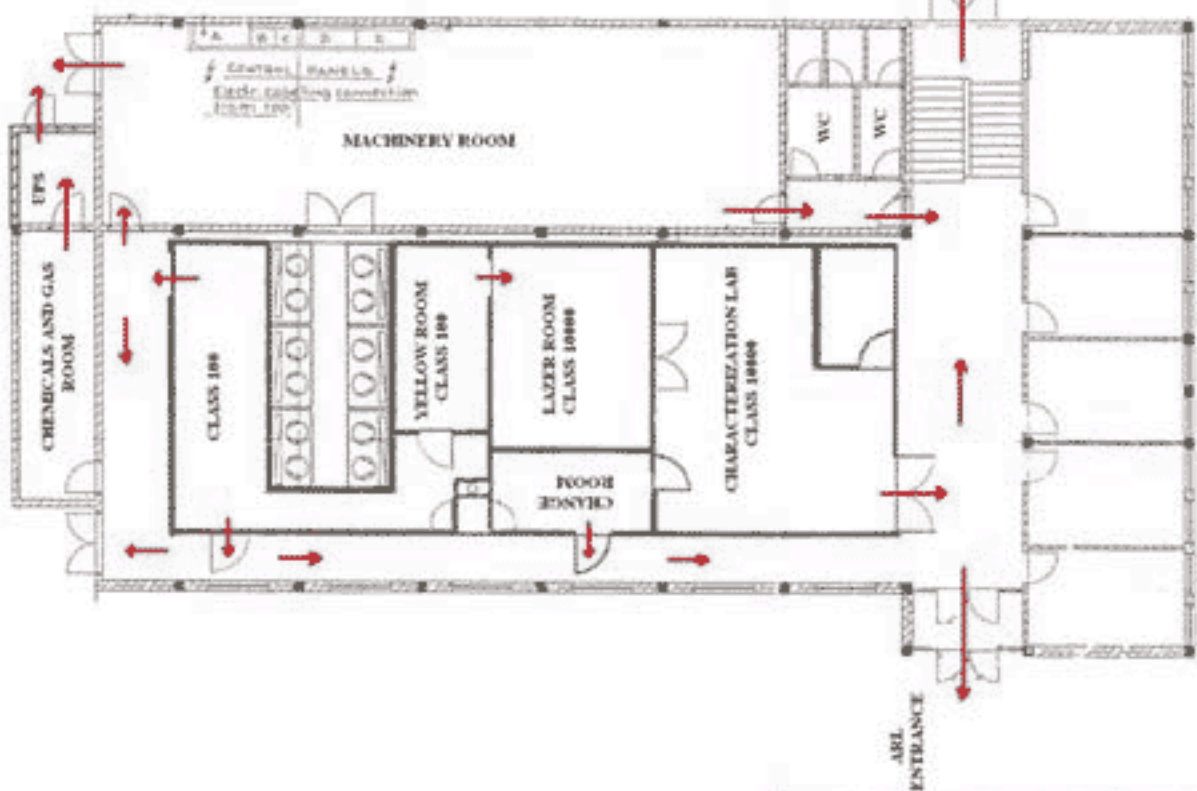

Approved by BILKENT
at MEETING 18. Oct 91

18. Oct. 1991
aa

item 9.23.7

- CONTROL PANELS**
- A = MAIN DISTRIBUTION (BILKENT)
 - B = EMERGENCY DISTRIBUTION
 - C = STANDARD DISTRIBUTION
 - D = AIR CONDITIONING PANEL
 - E = AIR CONDITIONING PANEL
 - F = FIRE PROTECTION BOX
 - G = LIGHTING BOX
 - H = CHILDER (DIRECT CONNECTION)

The drawing and the design it covers are the property of MEISSNER+WURST. They are hereby loaned and on the borrower's express agreement that they will not be reproduced, copied, stored, exhibited or used except in the limited way and under the control of any written consent given by the lender to the borrower. The drawing and all attachments are to be returned immediately if no order is placed with us.

Date	Name	Index

Alterations

1991	Date	Name	Comm. No.
Drafted	07.05.	Walschank	117371
Checked			

MEISSNER+WURST GmbH + Co
 Integrated Clean Systems, Facility Engineering, General Contracting
 Meissner 35, P.O. Box 71430, D-1000 Stuttgart 21
 Federal Republic of Germany
 Tel: (0714) 70552-0 Fax: (0714) 70552-220 Telex: 72075

Scale: 1:150
 Clean room ce. 100/10000
 Ref. BILKENT University